

Test Report No. 7191338137-MEC24/02-KDA
dated 17 Feb 2025



**Add value.
Inspire trust.**

Note: This report is issued subject to the Testing, Certification, Validation and Verification Regulations (TCVVR) of the TÜV SÜD Group and the General Terms and Conditions of Business of TÜV SÜD PSB Pte Ltd. In addition, this report is governed by the terms set out within this report.

SUBJECT:

Laboratory measurement of airborne sound insulation loss of single glazed partition system submitted by SAAS Solutions Pte Ltd on 13 Nov 2024.

TESTED FOR:

SAAS Solutions Pte Ltd
151 Chin Swee Road
#13-02 Manhattan House
Singapore 169876

Attn: Mr. Zack Chua

DATE OF TEST:

15 Nov 2024

DESCRIPTION OF SAMPLES:

One set of single glazed partition with 12mm thick tempered glass was installed onto a filler wall of the sample carrier.

Brand Name : SAAS Solutions
Model : S108 Offset Single Glazed
Overall nominal size (include frame) : 1200mm (width) x 2400mm (height) x 108mm (thick)
Material composition : a) 12mm thick tempered glass;
b) Aluminium frame

The boundary perimeters and gaps of the entire single glazed partition system with tempered glass were filled up with sealant.

The technical drawings of the single glazed partition system with tempered glass were shown in Appendix.



		LA-2007-0380-A LA-2007-0381-F LA-2007-0382-B LA-2007-0383-G LA-2007-0384-G LA-2007-0385-E	LA-2007-0386-C LA-2010-0464-D LA-2018-0702-B LA-2018-0703-G LA-2020-0747-L	The results reported herein have been performed in accordance with the terms of accreditation under the Singapore Accreditation Council. Inspections/Calibrations/Tests marked "Not SAC-SINGLAS Accredited" in this Report are not included in the SAC-SINGLAS Accreditation Schedule for our inspection body/laboratory.
--	--	--	--	---

Laboratory:
TÜV SÜD PSB Pte. Ltd.
15 International Business Park
TÜV SÜD @ IBP
Singapore 609937

Phone : +65-6778 7777
E-mail: info.sg@tuvsud.com
https://www.tuvsud.com/sg
Co. Reg : 199002667R

Regional Head Office:
TÜV SÜD Asia Pacific Pte. Ltd.
15 International Business Park
TÜV SÜD @ IBP
Singapore 609937
TUV®



METHOD OF TEST:

The test was conducted in accordance with the following test standards.

- a) ISO 10140 - 2 : 2021 "Laboratory measurement of sound insulation of building elements"
Part 2 : Measurement of airborne sound insulation.
- b) ISO 717 - 1 : 2020 "Acoustics - Rating of sound insulation in buildings and of building elements"
Part 1 : Airborne sound insulation

Measured area of single glazed partition: 2.83m²

Air temperature in both source room and receiving room: 24°C

Relative air humidity in both source and receiving room: 66%

Receiving room volume: 160m³

Source room volume: 131m³

Location of the test: Acoustics Lab of TÜV SÜD PSB Pte Ltd

TEST EQUIPMENT:

The following instruments were used for the test:

- 1) A dual-channel real-time frequency analyser (B&K Type 2133)
- 2) One loudspeaker (JBL MPro MP415)
- 3) Two sets of ½" condenser microphone (B&K Type 4190)
- 4) Two sets of microphone preamplifier (B&K Type 2669)
- 5) A sound pressure level calibrator (Norsonic Type 1251)
- 6) A sound source amplifier (Crown model CE 1000)
- 7) Two sets of rotating microphone boom (B&K Type 3923)

A handwritten signature in black ink, appearing to read 'Kles' followed by a stylized flourish.



TEST PROCEDURES:

- 1) Instrumentation was set up according to ISO 10140 - 2.
- 2) Measurement system was calibrated using a sound level calibrator.
- 3) Background noise level of both source and receiving room were measured.
- 4) One loudspeaker was placed at one corner in the source room.
- 5) Sound source system was switched on to generate "White" noise and maintained at constant level. The measured sound pressure level in the receiving room was ensured to be 15dB higher than the background noise level.
- 6) Recording time for both rotating microphone booms was set to 64s which equals to the time taken by the booms to complete two revolutions.
- 7) Sound pressure level in the source room and the receiving room were measured simultaneously and the measurement was repeated for another 2 more times.
- 8) Step 6 and 7 were then repeated after the loudspeaker was moved to another corner in the source room.
- 9) One loudspeaker was placed at one corner of the receiving room to generate the "Pink" noise for reverberation time measurement.
- 10) The average of 2 measurements of reverberation time in the receiving room was conducted and the measurement was repeated for another 1 more time.
- 11) Step 9 and 10 were then repeated after the loudspeaker was moved to another corner in the receiving room.
- 12) The mean values of 6 readings of sound pressure level difference and 4 readings of RT values were calculated.
- 13) Values of sound reduction index (R) were determined for each 1/3 octave frequency band from 100Hz to 5kHz based on the mean values of step 12.
- 14) Weighted sound reduction index (R_w) and its adaptation terms (C ; C_{tr}) according to ISO 717-1 was determined at 500Hz frequency of the shifted reference curve.

A handwritten signature in black ink, appearing to be 'Kles' followed by a stylized flourish.



RESULTS:

Values of sound reduction index (R) of the tested single glazed partition with tempered glass was tabulated in Table 1. Sound Insulation Rating is computed according to ISO 717-1.

Table 1 : Measured Sound Reduction Index, R, and values of the shifted reference curve for $R_w = 31$

1/3 Octave Band Frequency (Hz)	Sound Reduction Index, R (dBL)	Shifted Reference Curve $R_w = 31$	Deficiency
100	25.2	12	0.0
125	26.6	15	0.0
160	28.6	18	0.0
200	29.1	21	0.0
250	31.6	24	0.0
315	32.6	27	0.0
400	34.4	30	0.0
500	36.0	31	0.0
630	35.8	32	0.0
800	34.3	33	0.0
1000	27.9	34	6.1
1250	24.3	35	10.7
1600	28.5	35	6.5
2000	30.2	35	4.8
2500	33.0	35	2.0
3150	34.7	35	0.3
4000	39.6	35	0.0
5000	42.7	35	0.0
Total deficiency (100Hz – 3150Hz)			30.4

The values in Table 1 were plotted as shown in Figure 1.

Remark:

The tested "S108 Offset Single Glazed" partition system with 12mm thick tempered glass achieved a weighted sound reduction index, $R_w (C; C_{tr}) = 31 (-2; -2)$.

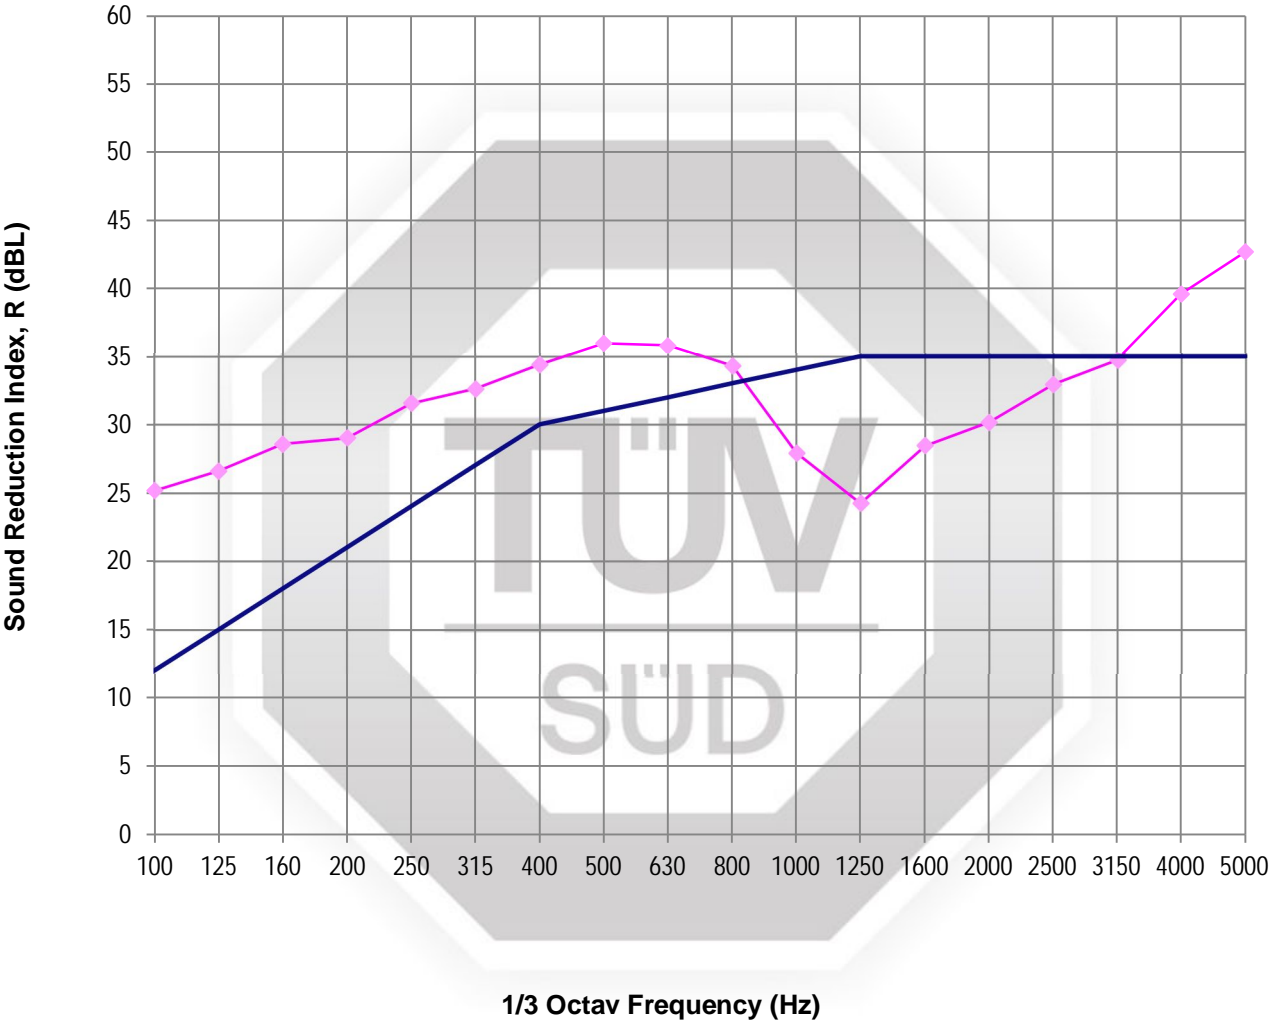

Klenplir Drequito Antimano
Testing Officer


Francis Ee Min Kuen
Engineer
Acoustics
Real Estate & Infrastructure - Mechanical



RESULTS (cont'd):

Figure 1: Sound Insulation Performance of "S108 Offset Single Glazed" Partition System with 12mm thick tempered glass (R_w 31)



—◆— Measured Sound Reduction Index, R
— Shifted Reference Curve, R_w = 31

RESULTS (cont'd):



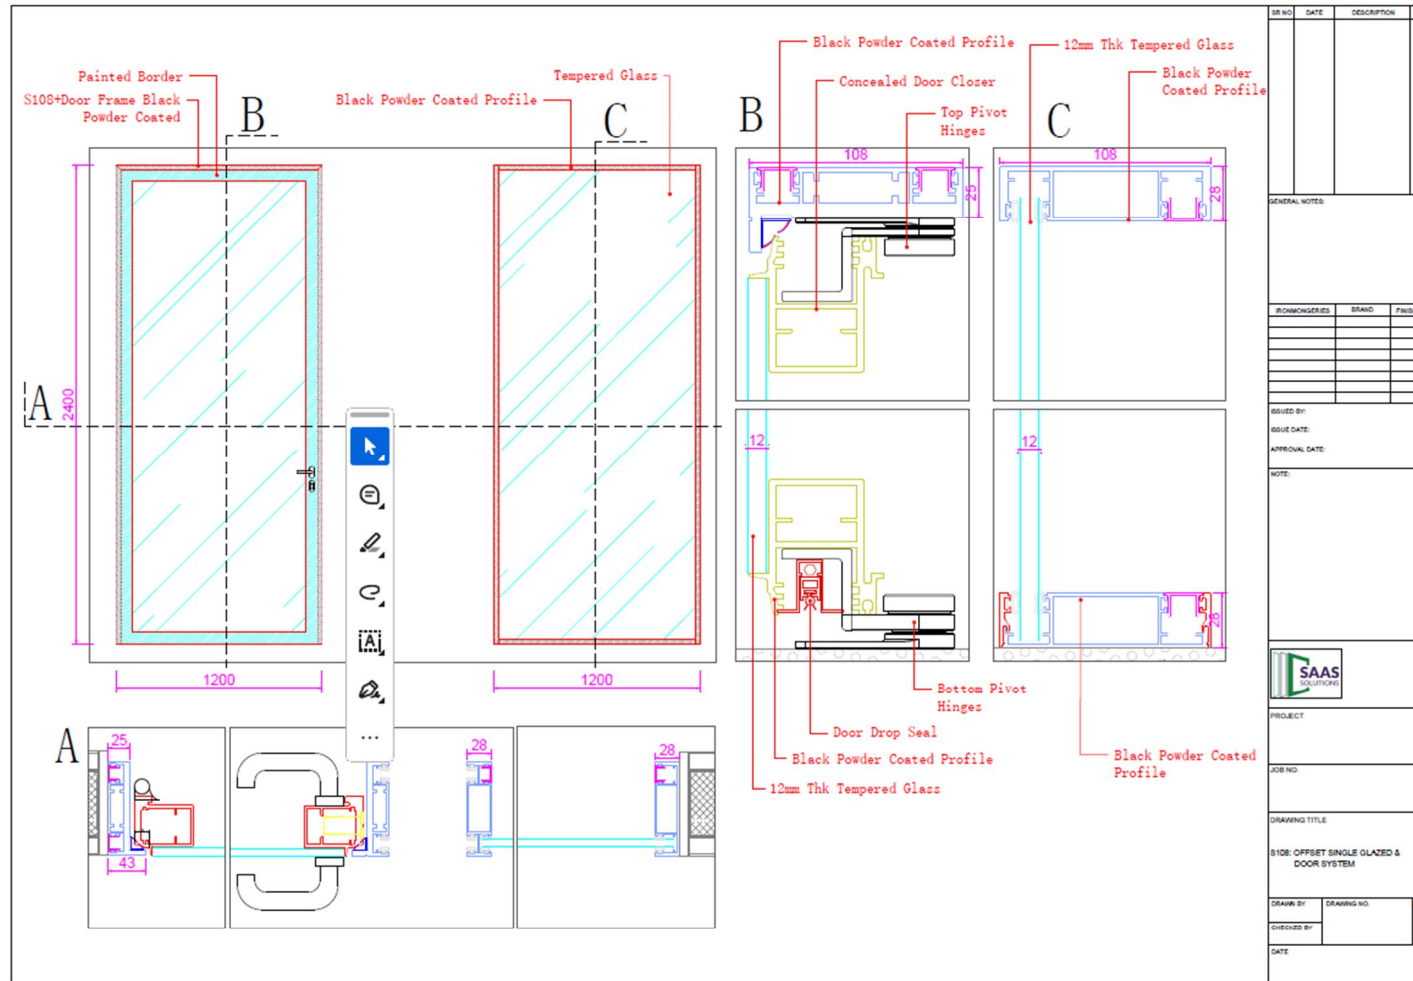
Figure 2 : “S108 Offset Single Glazed” partition with 12mm thick tempered glass facing the source room



Figure 3 : “S108 Offset Single Glazed” partition with 12mm thick tempered glass facing the the receiving room



Test Report No. 7191338137-MEC24/02-KDA
dated 17 Feb 2025



Appendix : Technical drawing of the "S108 Offset Single Glazed" partition system with 12mm thick tempered glass



Please note that this Report is issued under the following terms :

1. This report applies to the sample of the specific product/equipment given at the time of its testing/calibration. The results are not used to indicate or imply that they are applicable to other similar items. In addition, such results must not be used to indicate or imply that TÜV SÜD PSB approves, recommends or endorses the manufacturer, supplier or user of such product/equipment, or that TÜV SÜD PSB in any way "guarantees" the later performance of the product/equipment. Unless otherwise stated in this report, no tests were conducted to determine long term effects of using the specific product/equipment.
2. The sample/s mentioned in this report is/are submitted/supplied/manufactured by the Client. TÜV SÜD PSB therefore assumes no responsibility for the accuracy of information on the brand name, model number, origin of manufacture, consignment or any information supplied.
3. Nothing in this report shall be interpreted to mean that TÜV SÜD PSB has verified or ascertained any endorsement or marks from any other testing authority or bodies that may be found on that sample.
4. This report shall not be reproduced wholly or in parts and no reference shall be made by the Client to TÜV SÜD PSB or to the report or results furnished by TÜV SÜD PSB in any advertisements or sales promotion.
5. Unless otherwise stated, the tests were carried out in TÜV SÜD PSB Pte Ltd, 15 International Business Park TÜV SÜD @ IBP Singapore 609937.
6. The tests carried out by TÜV SÜD PSB and this report are subject to TÜV SÜD PSB's General Terms and Conditions of Business and the Testing, Certification, Validation and Verification Regulations (TCVVR) of the TÜV SÜD Group.

Effective 27 March 2024

